
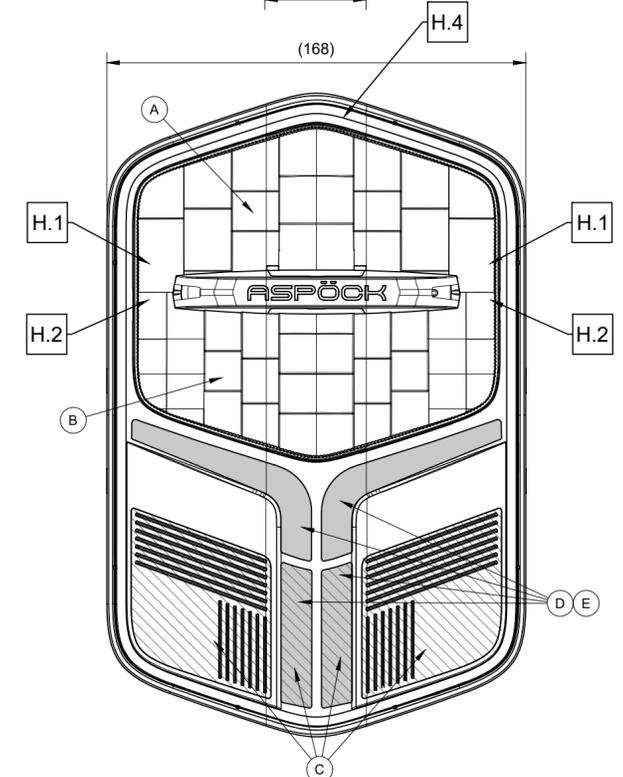
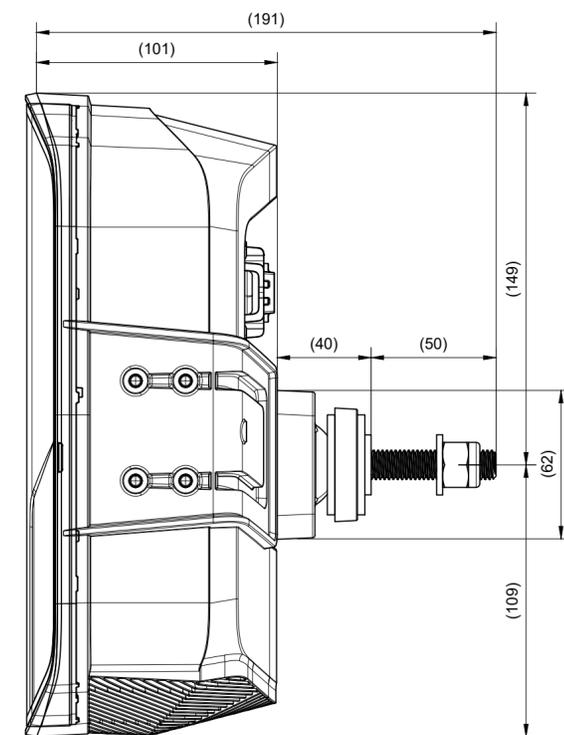
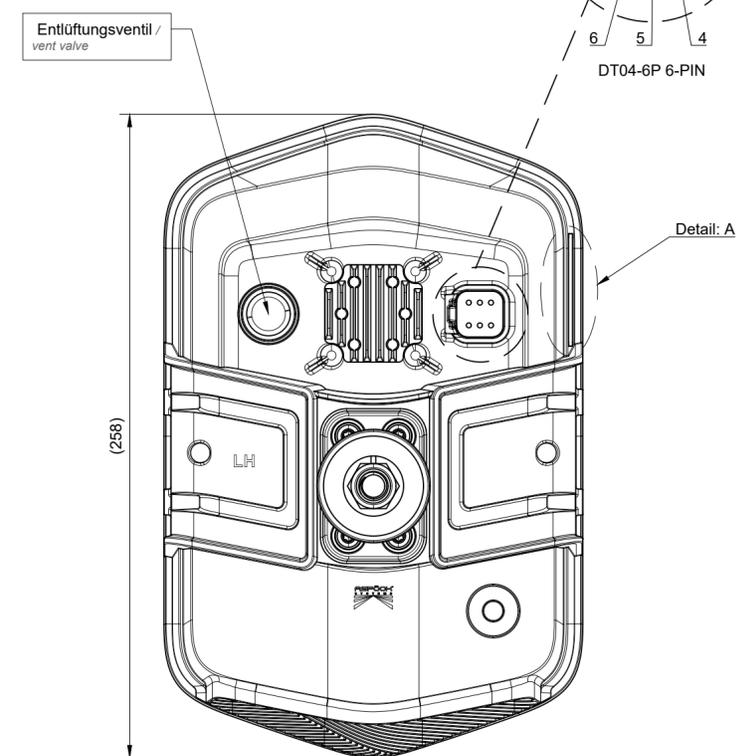
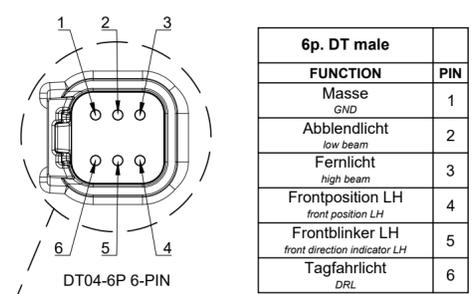
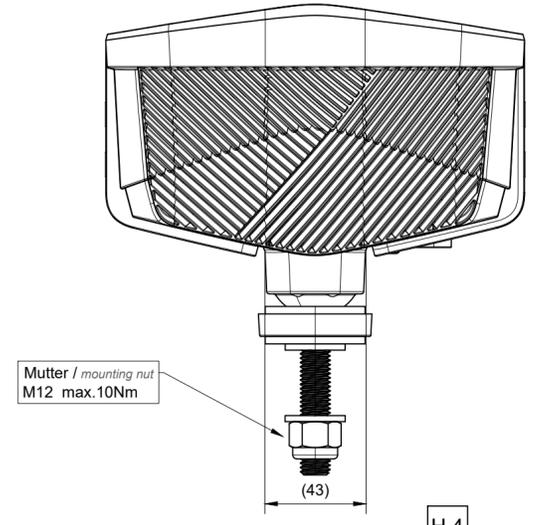


Level	Zone	ECI N°.	Revision note	Date	Designed	Checked

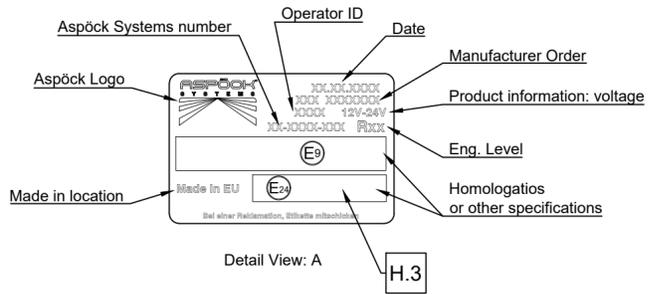

Electrical Specification				
Funktion / Function	Nennspannung / Nominal Voltage	Spannungsbereich / Voltage Range	Nennstrom / Nominal Current	Nennleistung / Nominal Power
	Volt (V)	Volt (V)	Ampere (A)	Watt (W)
Low Beam	12V / 24V	10V - 33V	0.9A / 0.46A	12.1W / 12.8W
High Beam	12V / 24V	10V - 33V	0.9A / 0.46A	12.1W / 12.8W
Frontposition	12V / 24V	10V - 33V	0.14A / 0.07A	1.8W / 1.9W
Front DI	12V / 24V	10V - 33V	0.98A / 0.42A	13.2W / 11.7W
DRL	12V / 24V	10V - 33V	0.65A / 0.33A	8.7W / 9.2W

FUNCTION:	
Abblendlicht low beam	A
Fernlicht high beam	B
Frontblinker LH front direction indicator LH	C
Frontposition LH front position LH	D
Tagfahrlicht Daytime Running Lights	E

Homologation description					
H.1	E9 1939 01	12.5	WCR-DS PL		
H.2	E9 23409 01	RL	A	1a	
H.3	E24 6483 06				
H.4	SAE I7 DRL PA F5 H 25 DOT				

Einbaurichtung / mounting direction

WCR-DS WCR-DS PL
 12V 24V 12V 24V
 12V 24V 12V 24V
 12V 24V 12V 24V
 12V 24V 12V 24V

CP_03-0_Bemaßungsrichtlinie () Auxiliary dimension DIN 406-10 Theoretical dimension ISO 1101
 Test dimension (SPC) [] Unfinished dimension DIN 406-10 Surface quality ISO 1302

Designed by Livinski Gabriela 2026/01/30 Checked by Strubreiber Daniel 2026/02/06 Approved by Schamberger Stefan 2026/02/09

Part Number 25-0421-077

ASPOECK SYSTEMS
 Designation: LuxLEDII V DRL DT CISPR25/3 LH
 Drawing Nr. 25042107
 Business Unit SALES - 12

Tolerance CP_04-2_Toleranzen Verkabelungsprodukte

Weight - Scale not in scale
 Level R01 Sheet 1 / 1

Transmittal, reproduction, dissemination and/or editing of this document as well as utilization of its contents and communication thereof to others without express authorization are prohibited. Offenders will be held liable for payment of damages. All rights created by patent grant or registration of a utility model or design patent are reserved.

AZ - AutoCAD 2023 / CP_03-0_Zeichnungsblatt Beschreibung

Schutzart in Verbindung mit passendem Gegenschalter.
 Bauartig geeignete ADR Installation, mind. IP54 erforderlich!
 Protection class in conjunction with suitable mating connector.
 Suitable ADR installation on site, at least IP54 required!

ADR-Zone 2 geprüft
 IP6K9K